BRUHAT BANGALORE MAHANAGARA PALIKE
YELAHANKA ZONE

Name of Work: Estimate for Engaging JCB and Tactor for removal of over burden earth and other debris in Ward No. 10 (Doddabommasandra), Vidyaranyapura Sub Division.

Estimate Cost: 500000.00

Sl No	Description of item	Unit	No	L	B	D	Qty	Rate	Amount
1	1031 - Providing J.C.B Excavator on Hire basis including Operator and Fuel (P. XXXXIV/I. 23) PWD SR 2015-16	Day							
			8				8		
							8	6720.00	53760.00
2	1024 - Providing Tractor 50 HP Hire Charges of including Operator and Fuel (P. XXXXIV/I. 19) PWD SR 2015-16	Day							
			1x90				90		
							90	2512.00	**226080.00**
3	Providing Causal Labours (Unskilled mazdoor Heavy) (PWD SR 2015-16 Page NoLII / I. 5)	Nos	1x10x90				900		
							900	244.55	**220095.00**
4	Miscellaneous								**65.00**
								Total	**500000.00**

ADMINISTRATIVE APPROVAL
Accorded For Rs. Five lakhs only
Head of A/c P-1771
Div. Ref. No. 2038 Date 14.12.15
AE
EE(BTP) 14/12

TECHNICAL SANCTION
Accorded For Rs. Five lakhs only
Head of A/c P-1771
Div. Ref. No. 212 Date 14.12.15
AE
EE(BTP) 14/12

(Rupees Five Lakhs Only)

Certificate:

1. The work spot has been inspected and the work is found necessary.
2. This estimate is prepared as per P.W.D S.R of 2015-16.
3. This work included under 2015-16 POW Grant.
4. The provisions were made in this estimate are necessary and adequate.
5. This works come under B.B.M.P. limits.

Executive Engineer
Byatarayanapura Division
BBMP, Bangalore-92
14/12/15

Assistant Engineer

Assistant Executive Engineer
Bruhat Bangalore Mahanagara Palike
Vidyaranayapura Sub Division
Bangalore-97.

Executive Engineer
Bruhat Bangalore Mahanagara Palike
Byatarayanapura Division
Bangalore-92

BRUHAT BANGALORE MAHANAGARA PALIKE

YELAHANKA ZONE, BYATARAYANAPURA DIVISION

Lead Statement for Srinivaspura Dumping Yard for Ward No. 10, Vidyaranyapura Sub Division.

Lead Distance

1.	From BBMP Sub Division office to Devi Circle	1.50 Kms
2.	From Devi Circle to Thirumala Daba	2.00 Kms
3.	From Thirumala Daba to 3rd Cross SBI Bank	2.00 Kms
4.	From 3rd Cross SBI Bank to Sheshadripuram College	0.50 Kms
5.	From Shesadripuram College to Police Station	0.80 Kms
6.	From Police Station to Kogilu Cross	0.60 Kms
7.	From Kogilu Cross to Srinivasapura	4.00 Kms
8.	From Srinivasapura to Dumping Yard	0.50 Kms
	Total	**11.90 Kms**

Certificate:

1. Certified that the Srinivasapura Dumping Yard us the approved dumping yard for ward no. 10 BBMP
2. BBMP Sub Division office Vidyaranyapura is taken as the centre place for calculating the lead distance for ward no. 10.
3. The above distance is the shortest distance for calculating the lead.

Assistant Engineer
Ward No. 10

Assistant Executive Engineer
Vidyaranyapura Sub Division

LOAD CHART FOR DUMPING-YARD FOR WARD NO

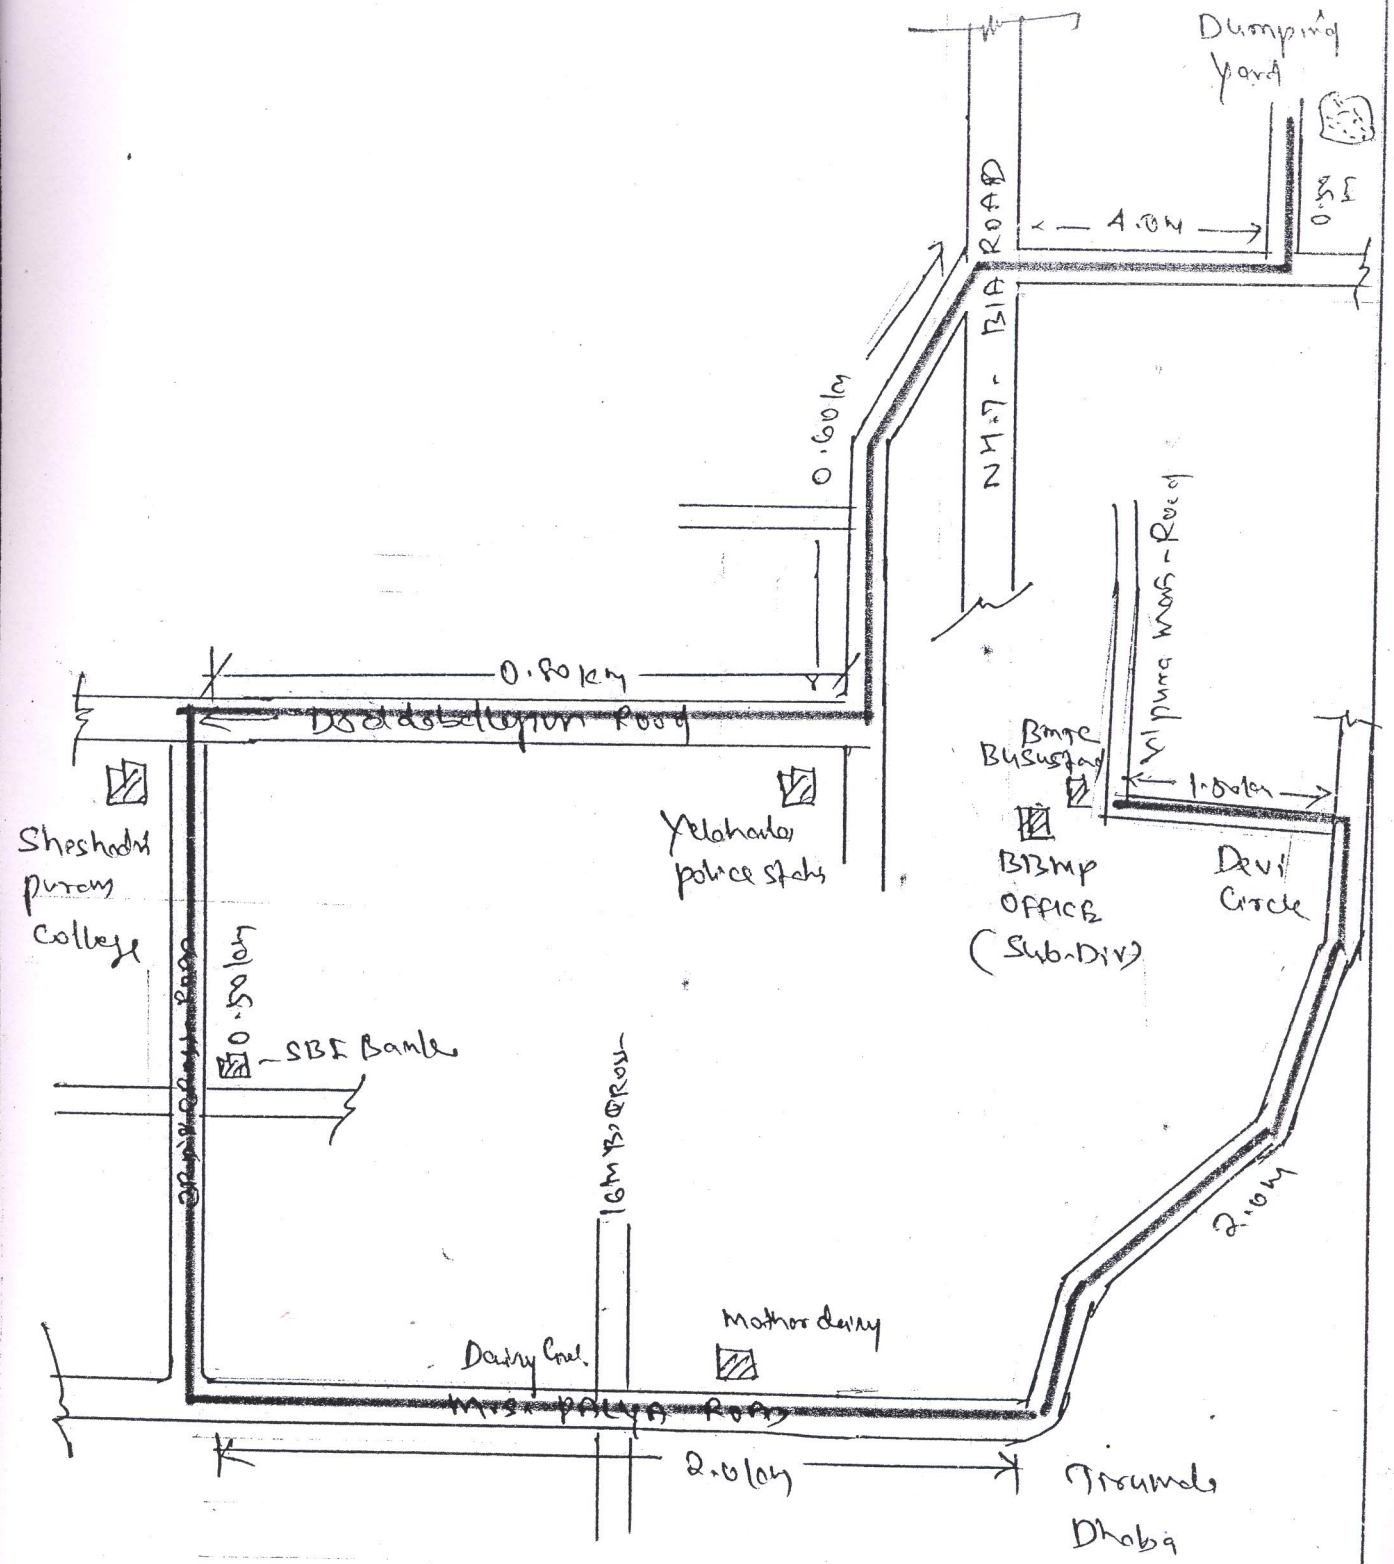

Jadhav
AE

ಸಹಾಯಕ ಕಾರ್ಯಪಾಲಕ ಅಭಿಯಂತರರು.
ವಿದ್ಯಾರಣ್ಯಪುರ ಉಪ ವಿಭಾಗ.
ಯಲಹಂಕ ವಲಯ.
ಬೃ. ಬೆಂ. ಮ. ಪಾ., ಬೆಂಗಳೂರು-97